LEGEND	
SYMBOL	DESCRIPTION
———	3PH – 15kV. OVERHEAD CABLE SYSTEM
—— /// ——	3PH – 4kV. OVERHEAD LINE SYSTEM
— — —	3PH – 4kV. UNDERGROUND CABLE (PILES) SYSTEM
△	TRANSFORMER LOCATION (4 kV) (POLE 14TD)
▭	FEEDER SWITCHGEAR LOCATION (4 kV)
▭	PROPOSED 24kV. SWITCHGEAR LOCATION
—/——/—	PROPOSED 24kV. XLP UNDERGROUND CABLE
△	TRANSFORMER LOCATION (4 kV) (PAD MOUNTED)
Ⓡ	CLOSED RING UNIT

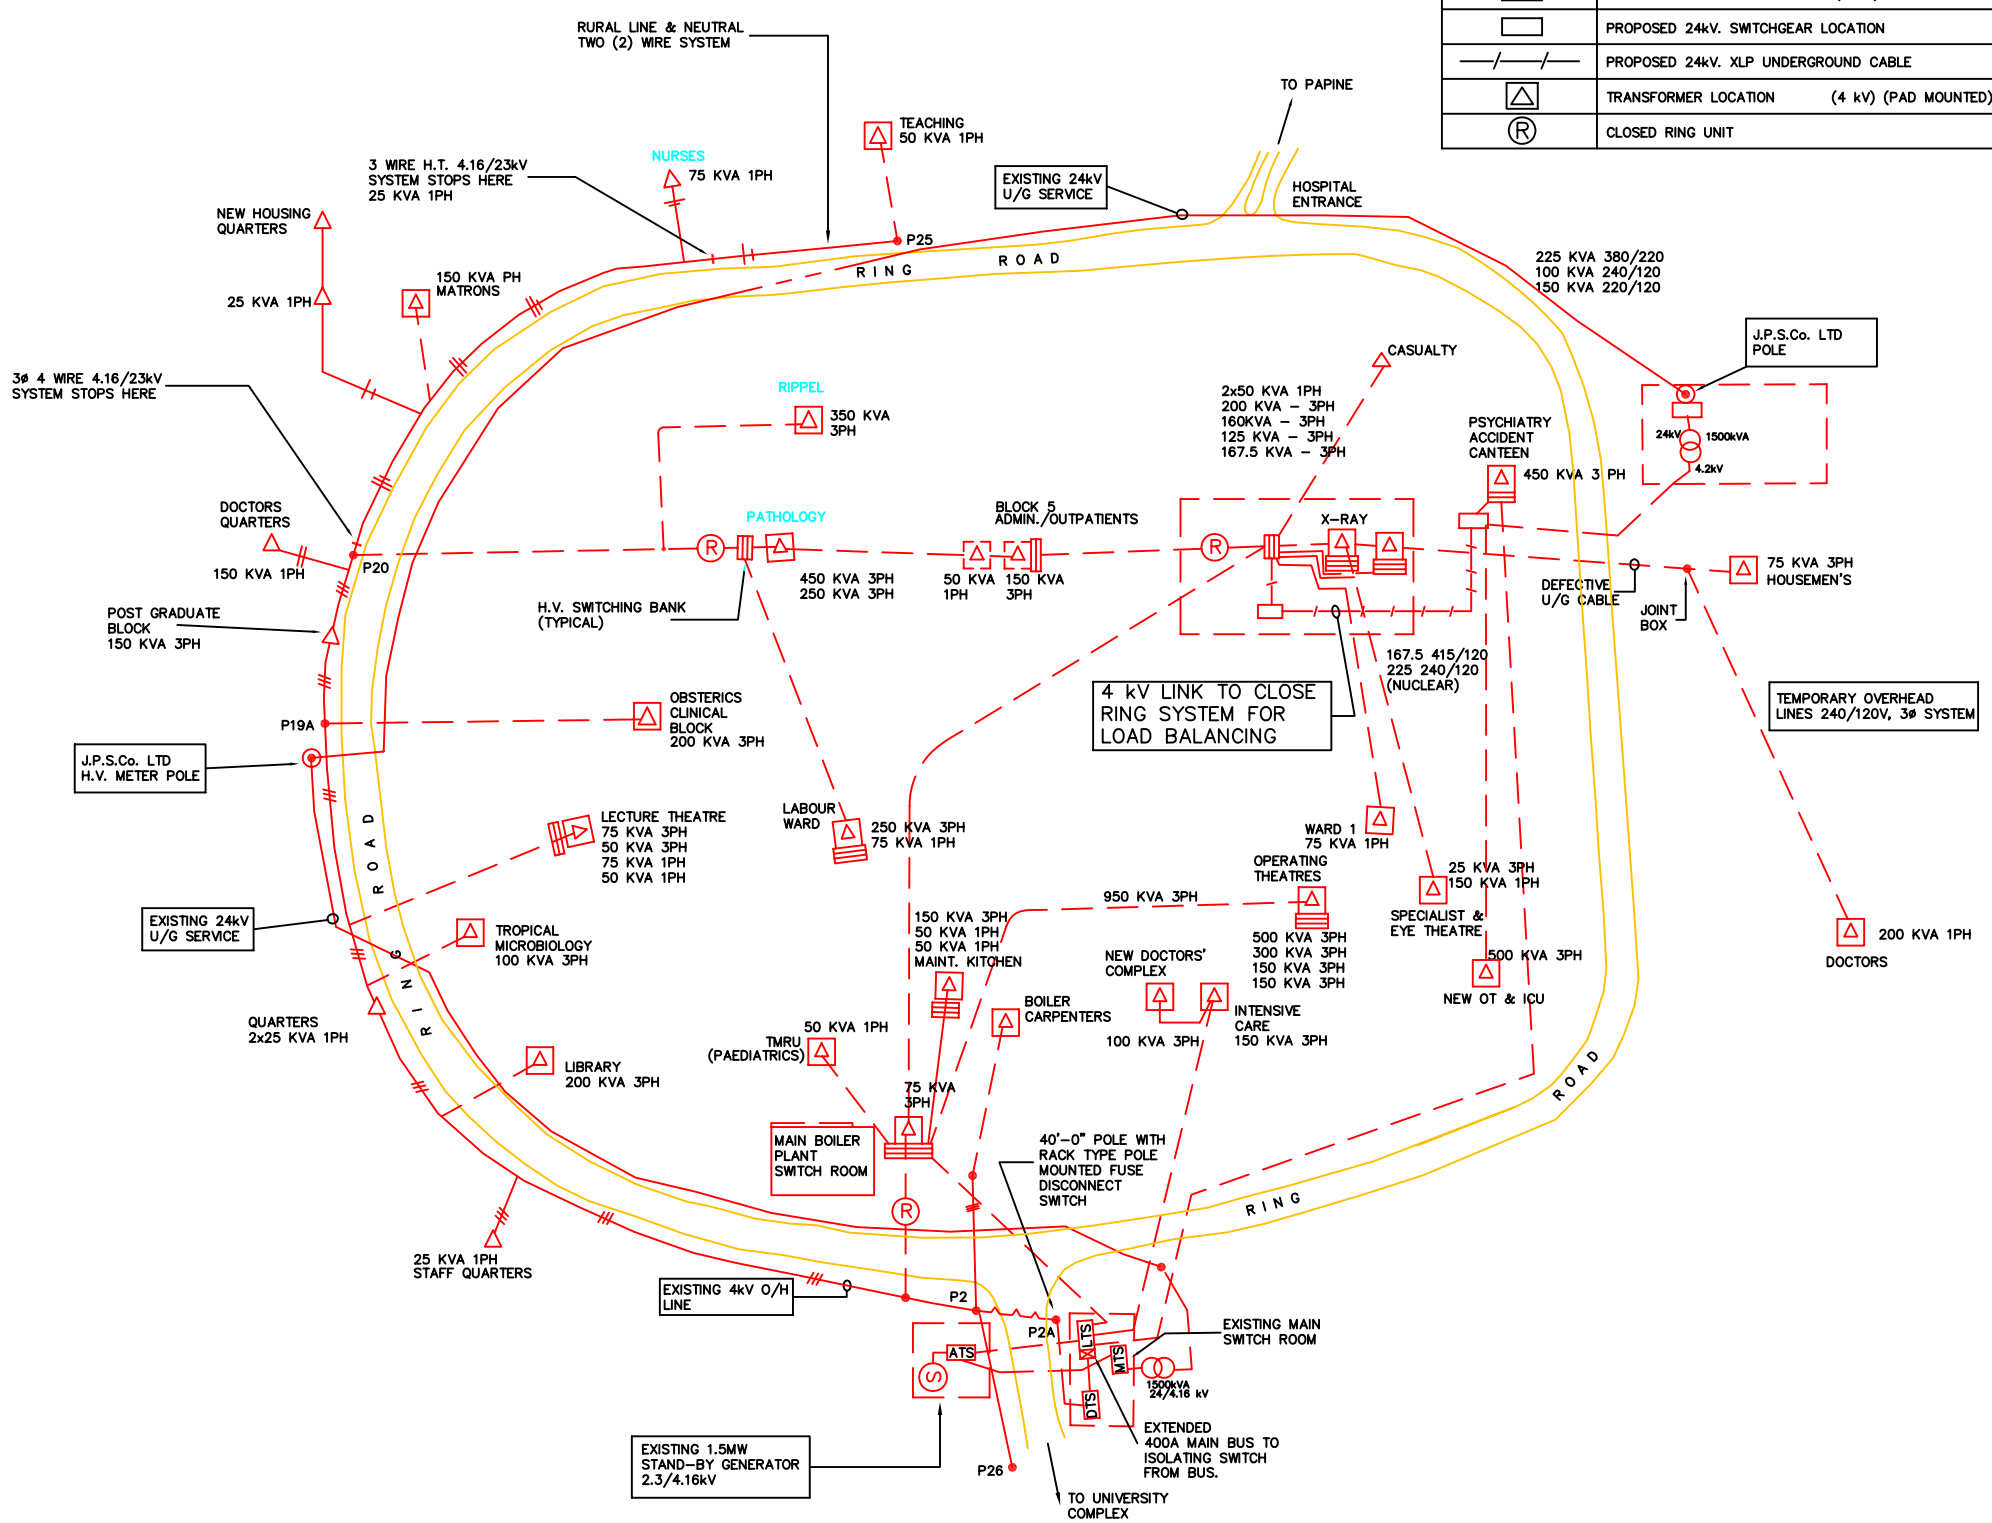

NOTES

no.	description	date	intl.
	REVISIONS		

client
UNIVERSITY HOSPITAL OF THE WEST INDIES - MONA JAMAICA

project
ELECTRICAL POWER DISTRIBUTION SYSTEM.

10 Central Road, Kingston 10 JAMAICA
Tel. (876) 926-5555
Fax. (876) 929-2956
Mike McIntyre & Associates Ltd.
Electrical & Electronic Engineering Consultants

drawing
EXISTING 4 KV DISTRIBUTION

NORTH

drawn	date	job no.
m.m.a.	JAN.01	MM/UH/MV01
scale		drawing no.
N.T.S.		HV-1

1. Do. not scale from drawing
2. All dimensions must be cross–checked by the contractor before and during construction and any discrepancies noted, must be reported immediately to the Architect.